





**FIRE INSPIRED<sup>®</sup>**

**CSA CERTIFIED-OUTDOOR USE ONLY  
FOR COMMERCIAL AND RESIDENTIAL USE**

HEARTH PRODUCTS CONTROLS  
2225 LYONS RD.  
MIAMISBURG, OH 45342  
TOLL FREE: 877.585.9800  
PHONE: 937.436.9800  
[www.hpcfire.com](http://www.hpcfire.com)

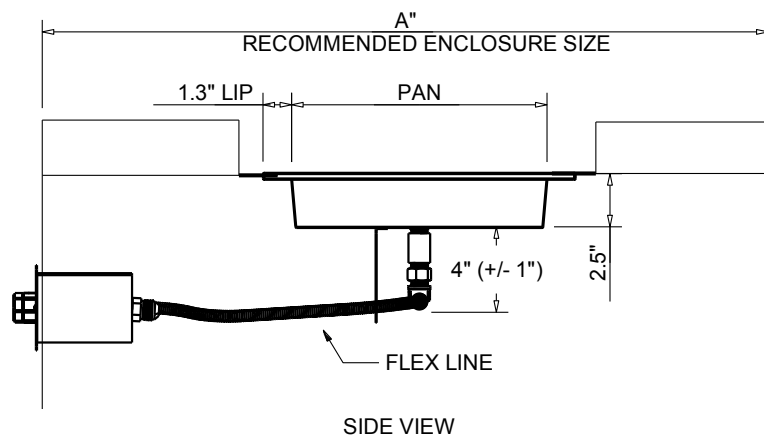


SIDE VIEW

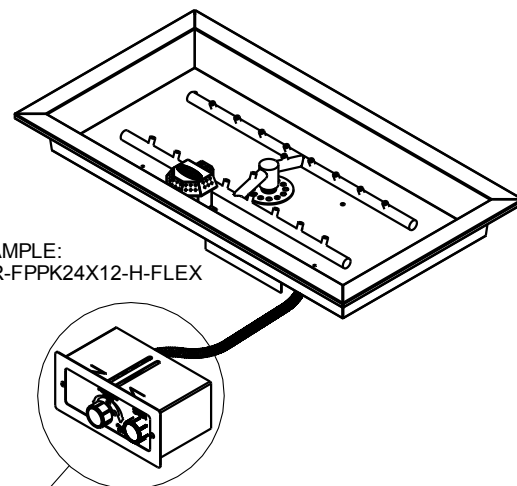

EXAMPLE:  
TOR-FPPK24X12-H-FLEX

ISOMETRIC VIEW

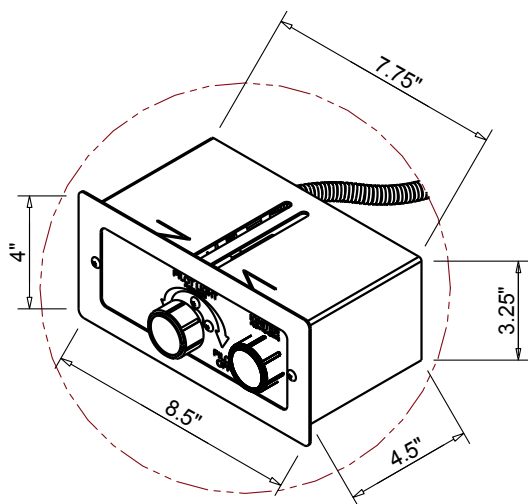

VALVE BOX DETAIL

SPARK IGNITION BY AA BATTERY  
MATERIAL: 304 STAINLESS STEEL

PART NUMBERS		PAN	DIMENSION CHART			
			STANDARD BTU		A"	STND FLEX LINE LENGTH
			PENTA	TORPEDO		
TOR-	FPPK24X12-H-FLEX	24"X12"	75K	115K	56LX28W	36"
TOR-	FPPK30X12-H-FLEX	30"X12"	90K	150K	56LX28W	36"
TOR-	FPPK36X14-H-FLEX	36"X14"	90K	150K	64LX32W	36"
TOR-	FPPK42X14-H-FLEX	42"X14"	140K	200K	64LX32W	36"
TOR-	FPPK54X16-H-FLEX	54"X16"	140K	200K	76LX38W	36"

\*FOR TORPEDO BURNERS ADD TOR-

**Notes:**

**1. PROPER VENTING**

- ENCLOSURES: Recommend 4 each 18 sq.in. vents on opposing sides (Minimum 2 each 18 sq.in. vents).

**2. GAS SUPPLY - FOR USE WITH FIXED PIPING SYSTEMS OR FOR USE WITH SMALL TANKS UP TO 90K.**

- Natural Gas: Operating Supply Pressure: Minimum: 6.0" W.C.; Maximum: 7.0" W.C.
- LP Gas: Operating Supply Pressure: Minimum: 10.0" W.C.; Maximum: 11.0" W.C.

IMPORTANT: Ensure any flex line that may be used from the permanent main fuel supply to the product is rated to the stated max btu of the product and certified to ANSI Z21.75\*CSA 6.27.

**5. MODIFICATION OF PRODUCT WILL VOID ANY CERTIFICATION AND WARRANTY.**

**6. FOLLOW ALL MANUFACTURER INSTALLATION INSTRUCTIONS AND LOCAL CODES.**


**7. ALL DIMENSIONS ARE CONSIDERED TRUE AND REFLECT MANUFACTURER'S SPECIFICATIONS AS OF THE REVISION DATE.**

**8. DO NOT SCALE DRAWING.**

**9. THESE DRAWINGS ARE FOR SIZING AND PLANNING PURPOSES. ALL INFORMATION CONTAINED HEREIN WAS CURRENT AT THE TIME OF DEVELOPMENT. THE MANUFACTURER'S RESPONSIBLE FOR THE ACCURACY OF THE DRAWING.**

**10. CONTRACTOR'S NOTE: FOR PRODUCT AND COMPANY INFORMATION VISIT [www.CADdetails.com/info](http://www.CADdetails.com/info)**

REFERENCE NUMBER 771-002.



**PUSH BUTTON/FLAME SENSING FIRE PIT INSERT - WITH FLEX LINE**

**RECTANGLE PAN - FPPK**