


TYPICAL INSTALLATION OF ELECTRONIC IGNITION

****24V-40VA TRANSFORMER REQUIRED****

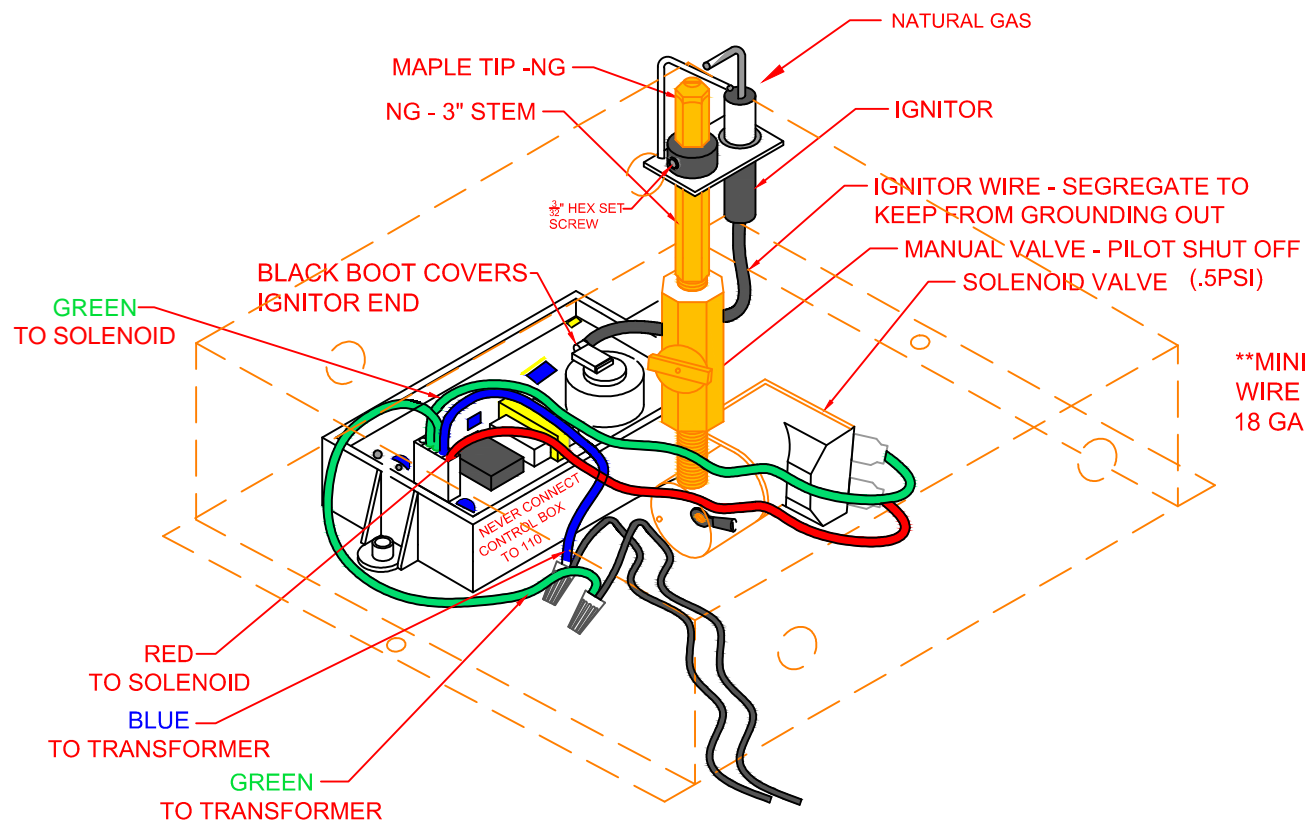

- (1) NG 3451 BTU
- (2) LP 2800 BTU
- (3) 4854 BTU


NG - 7" W.C.
LP - 11" W.C.

****WHEN CONNECTING MORE THAN ONE LIGHT, POLARITY MUST BE CONSISTENT****

****110 TO 24 VOLT 40 VA A.C. CLASS II-MAGNETIC TYPE TRANSFORMER**


****CONTROL BOX APPROX.**
.380 OHMS**

CONTROL BOX IS MOUNTED UPSIDE DOWN UNDER A COPPER COVER



PROPANE BURNER STEM

PROPANE FLAME SPREADER



PROPANE REGULATOR



****PROPANE BURNER STEM IS DIFFERENT FROM NG & ALSO NEEDS REGULATOR (1.4" W.C.)**

Fine's Gas
2777 Lafayette Road
Fort Oglethorpe, GA 30742
706-866-8290
www.finesgas.com



PATENTED FLAME



COPPER SCULPTURES INC. & LEGENDARY LIGHTING

JEREMY SHOOK-TECH.SUPPORT/SERVICE

PH. 800-235-6725 or 601-992-9955
FX. 601-992-9350